






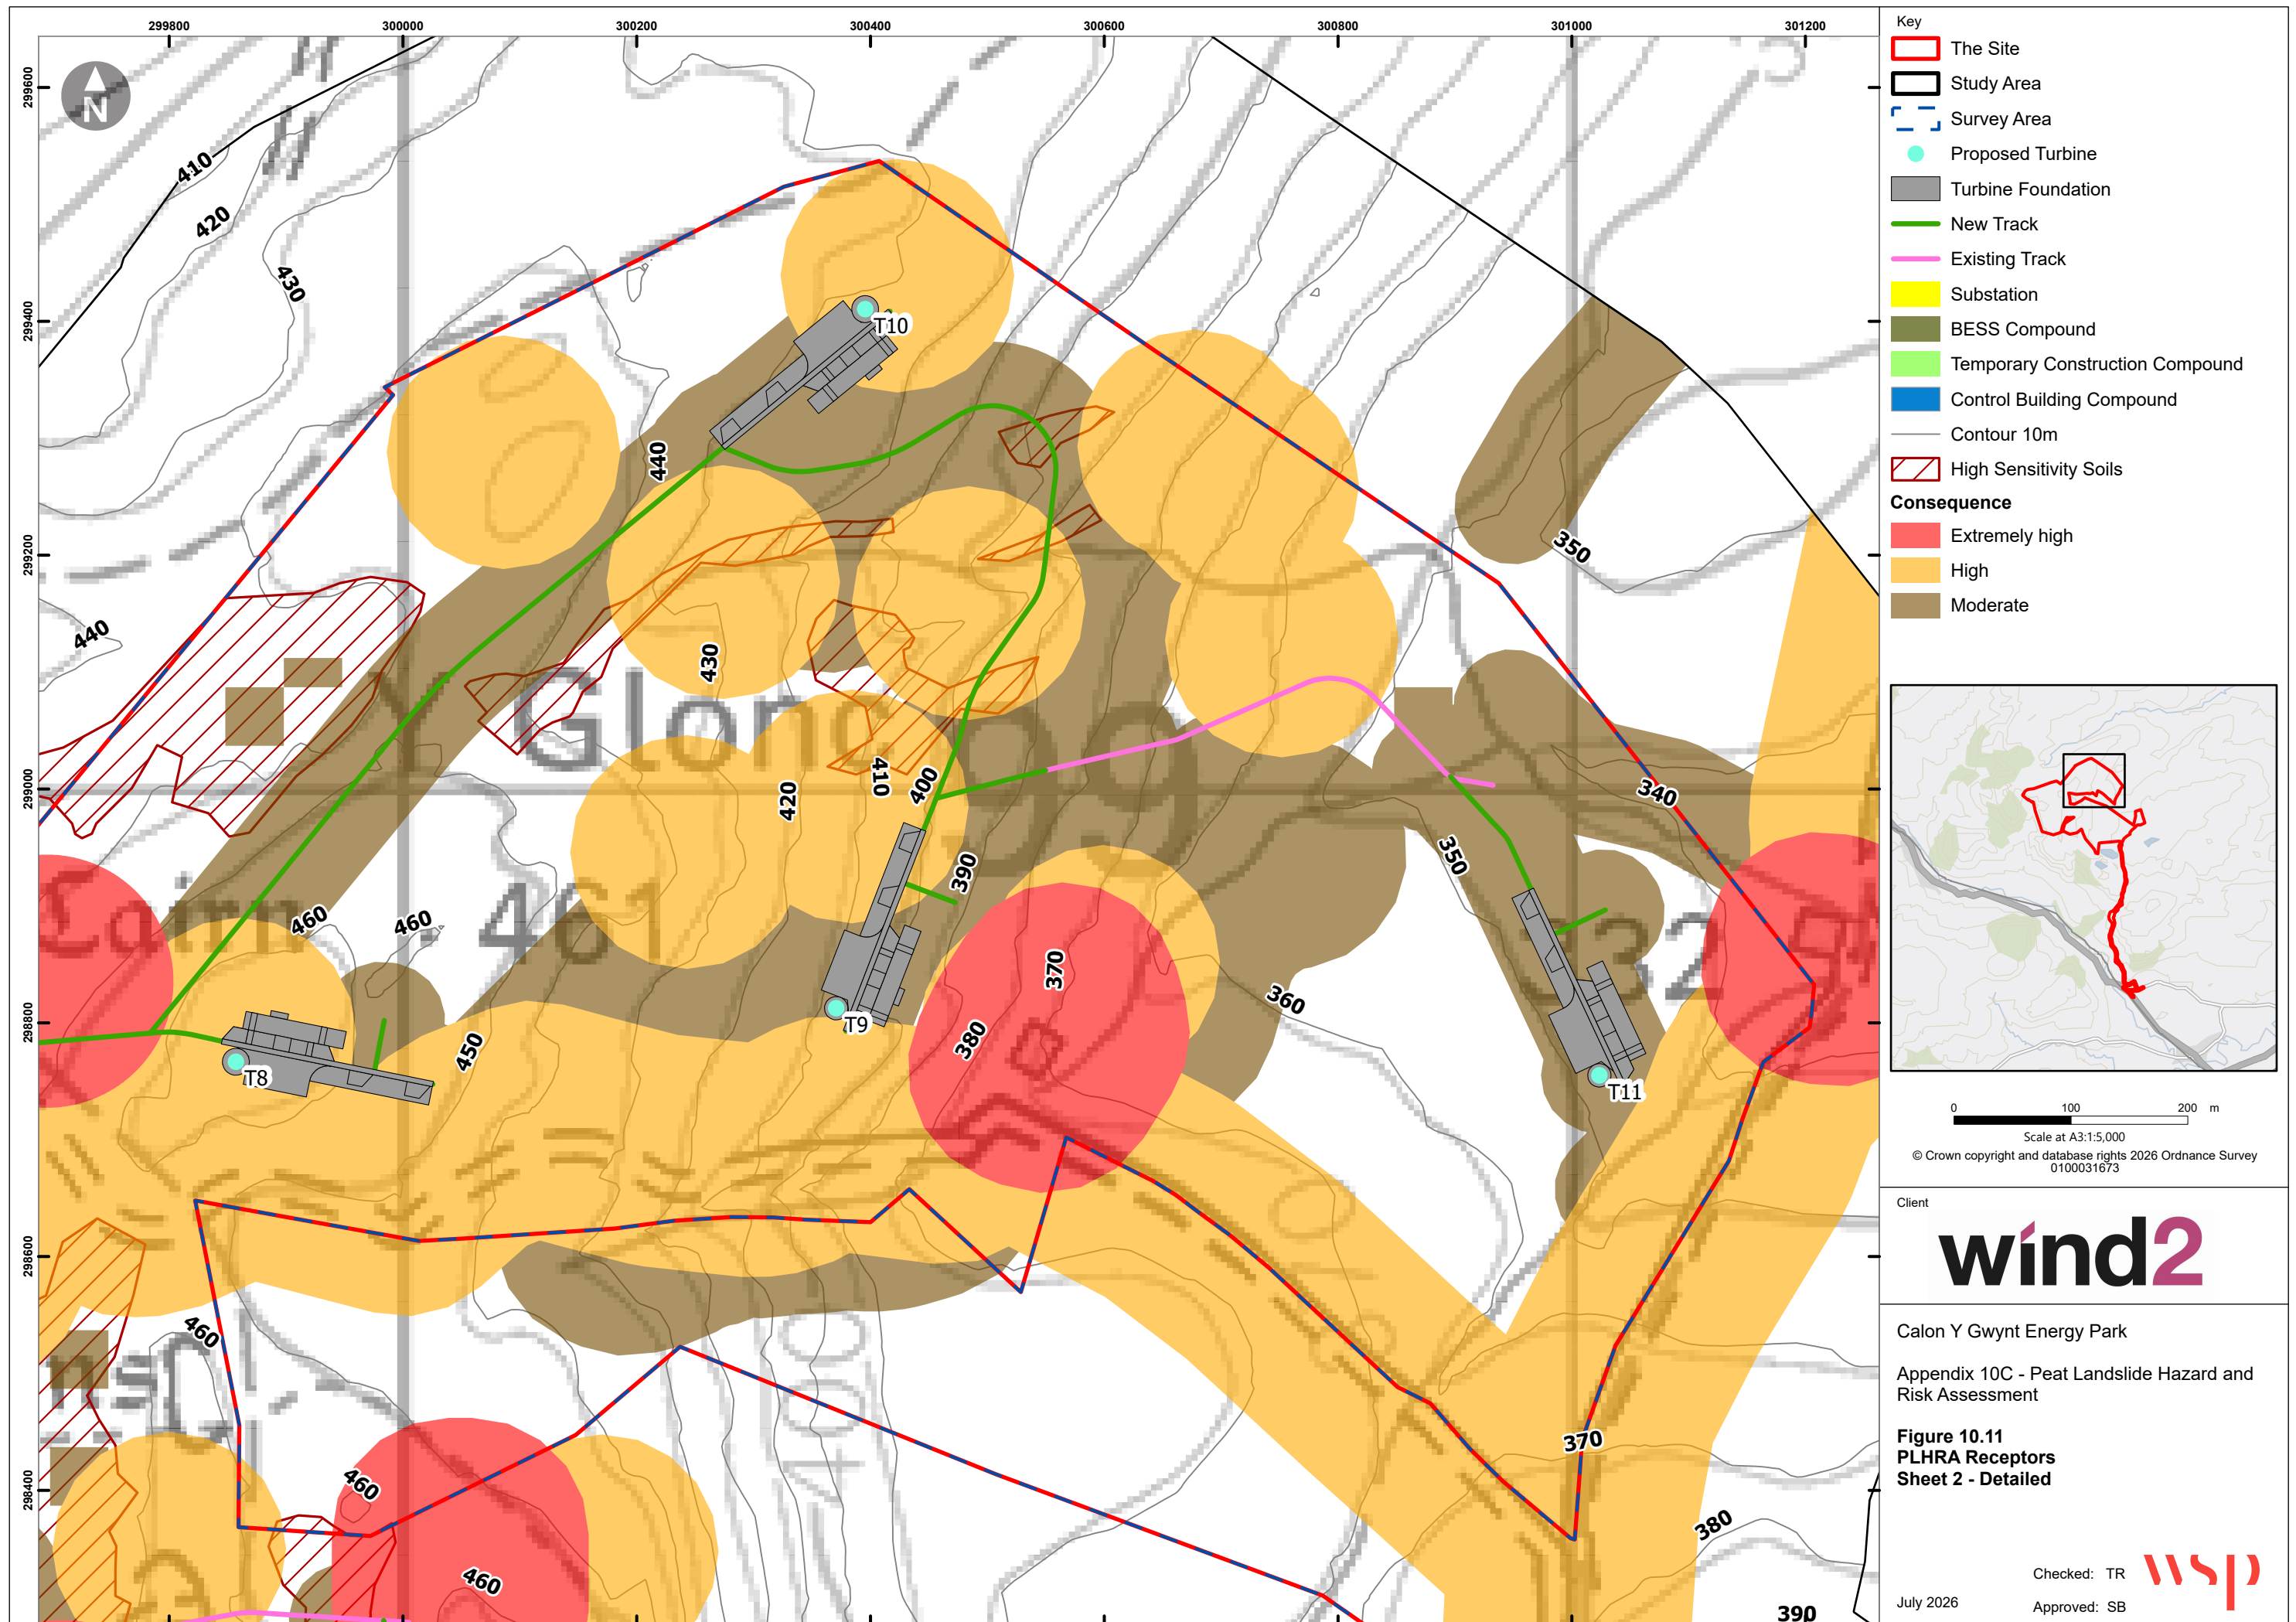


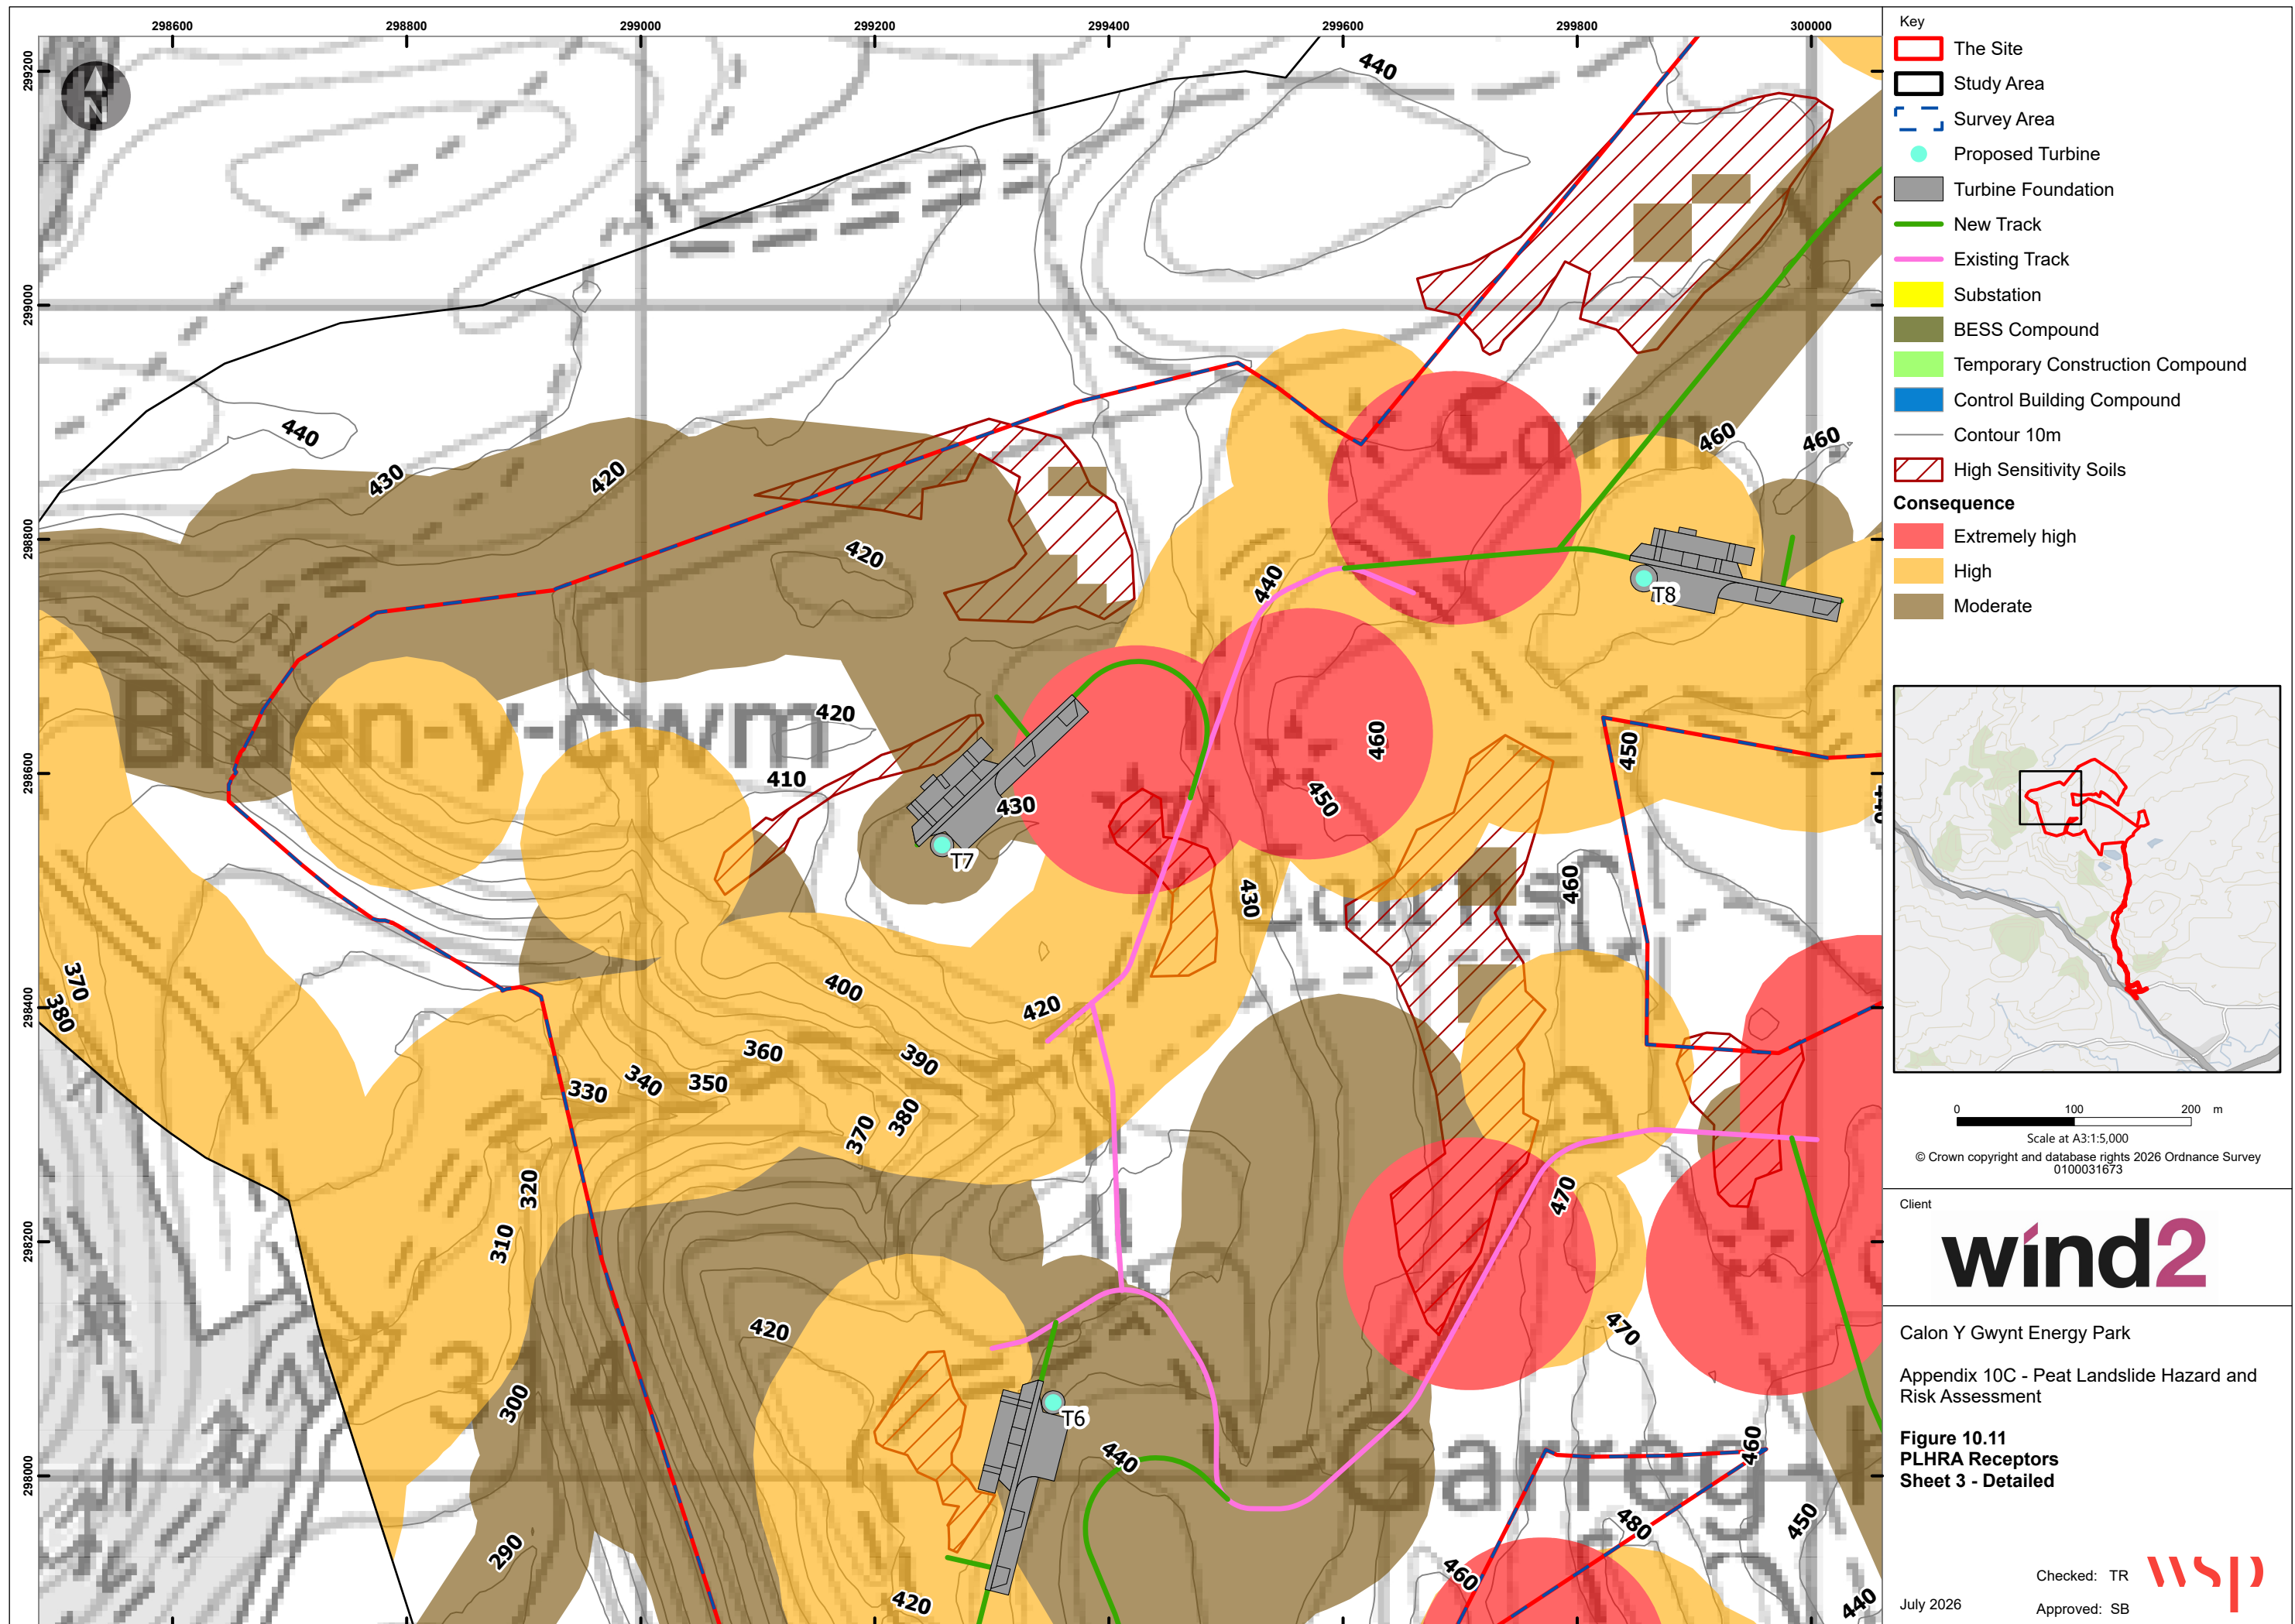


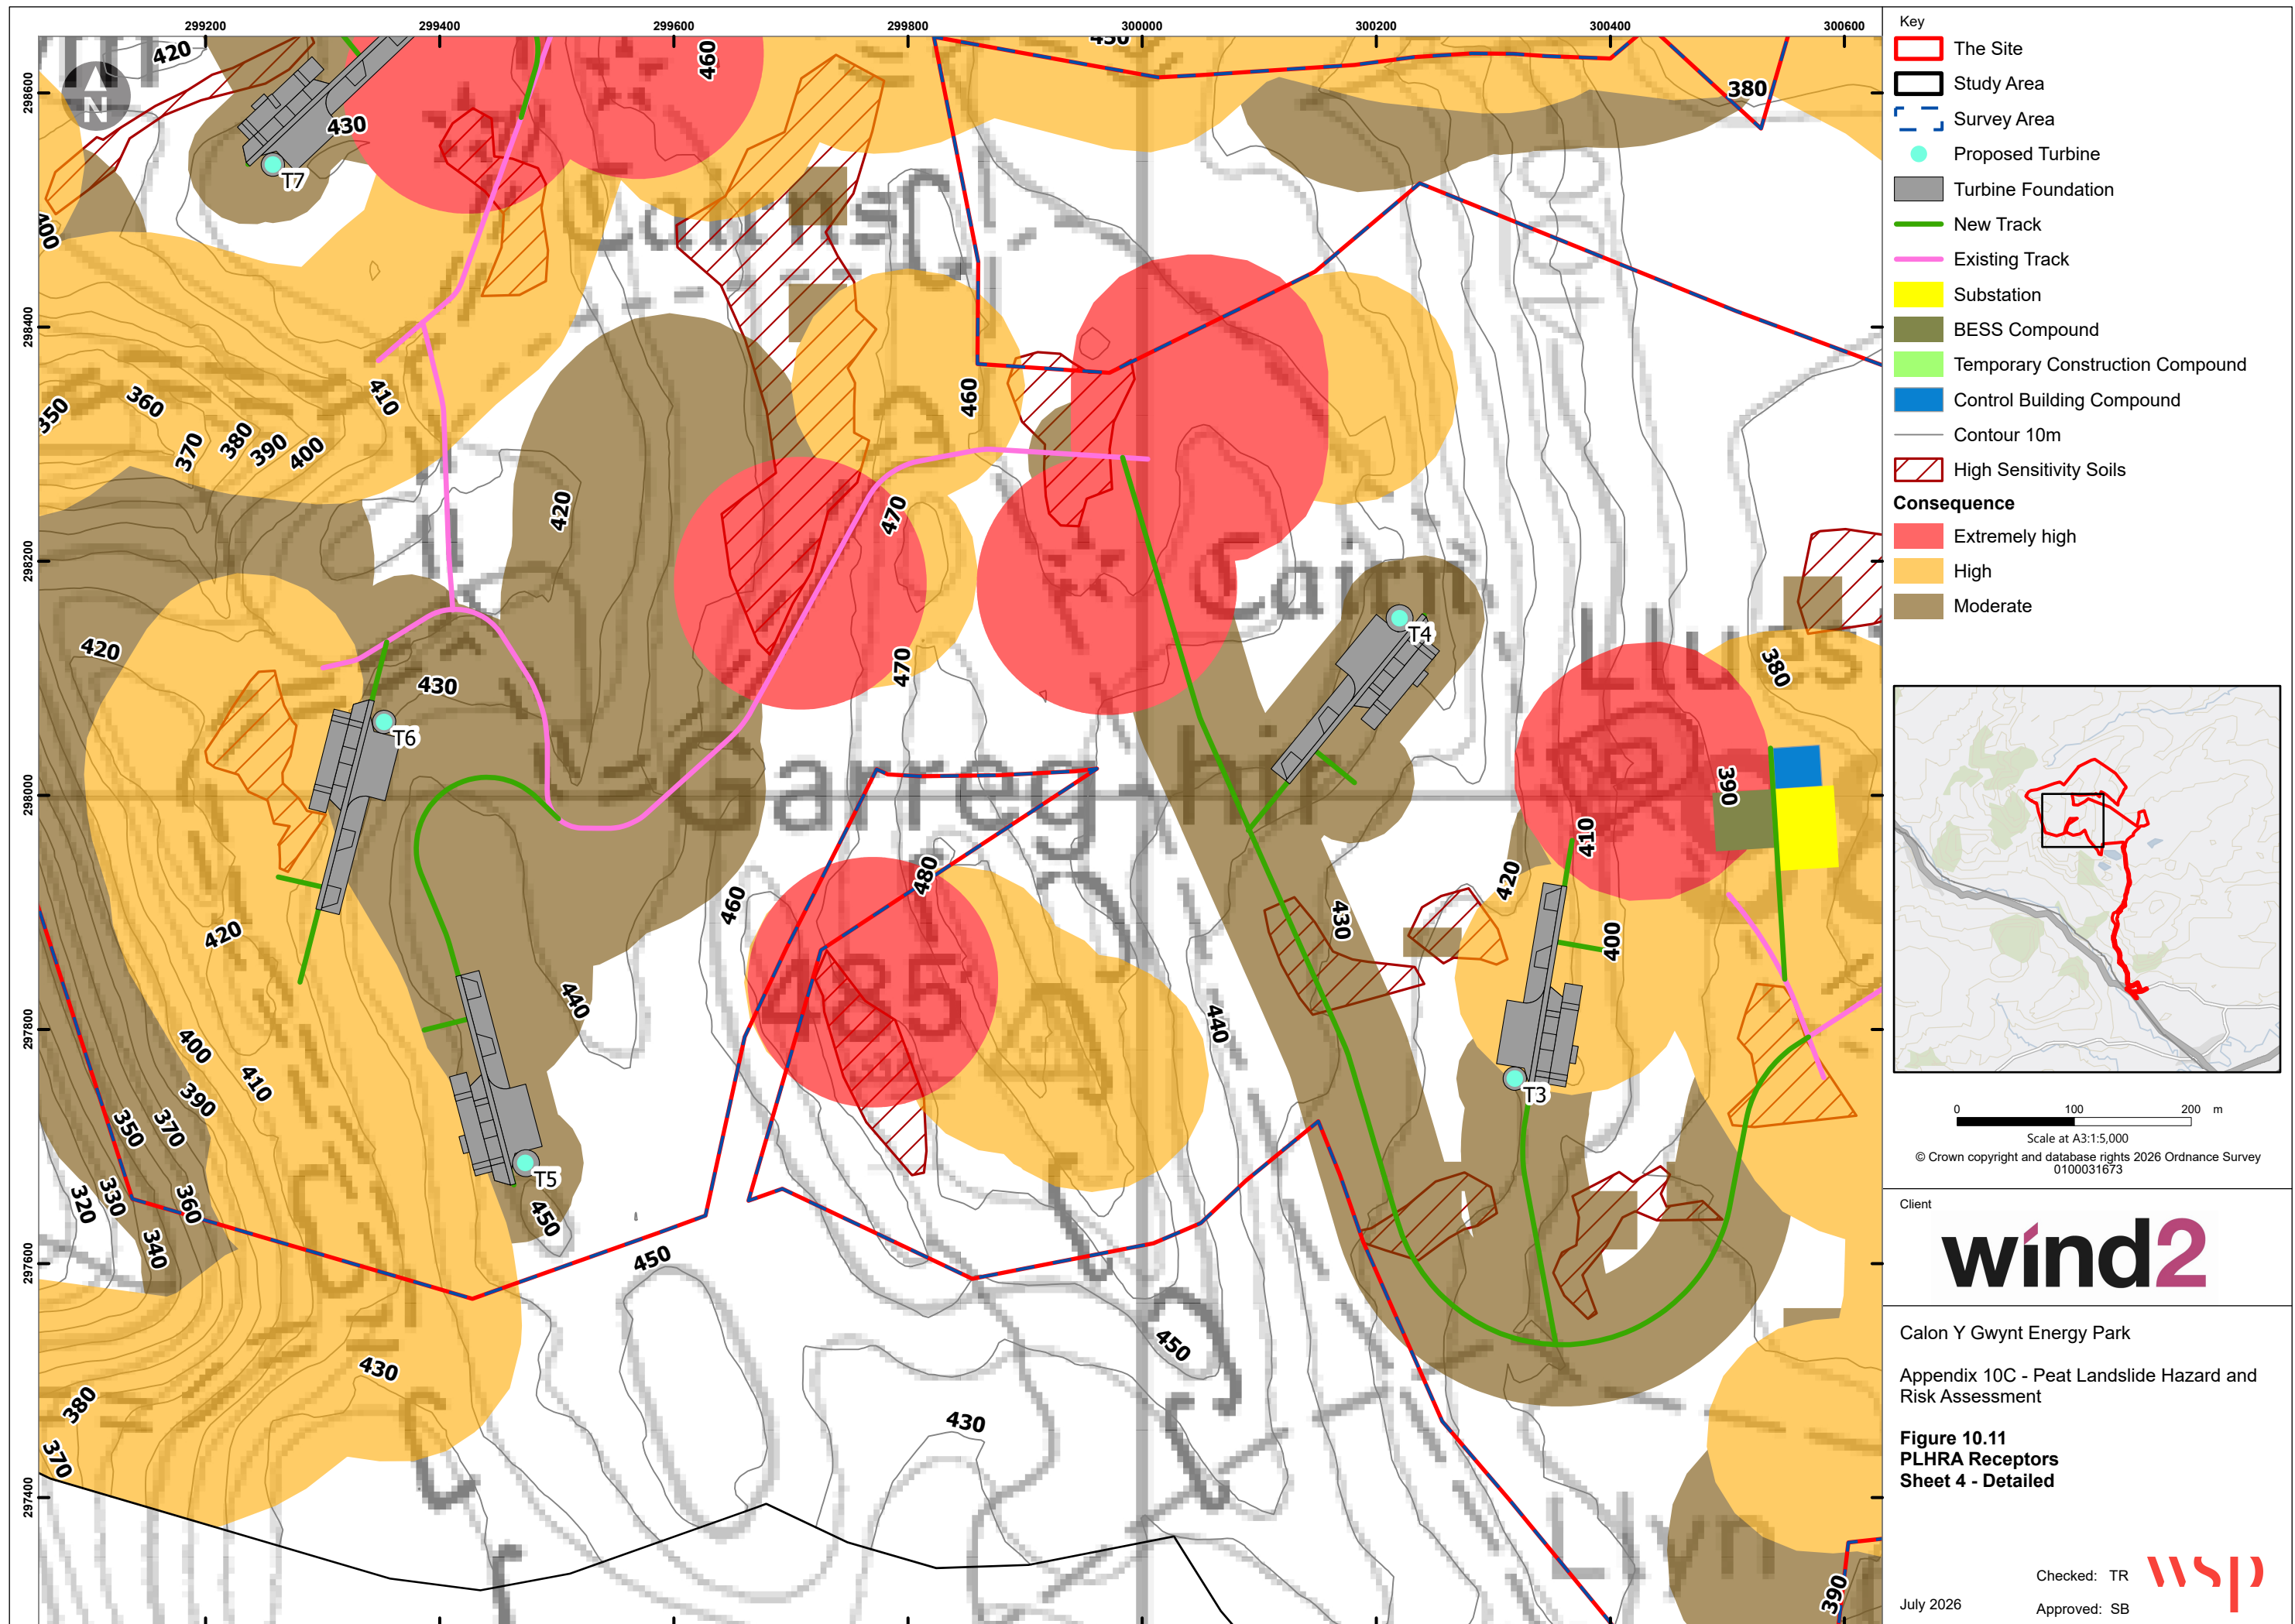

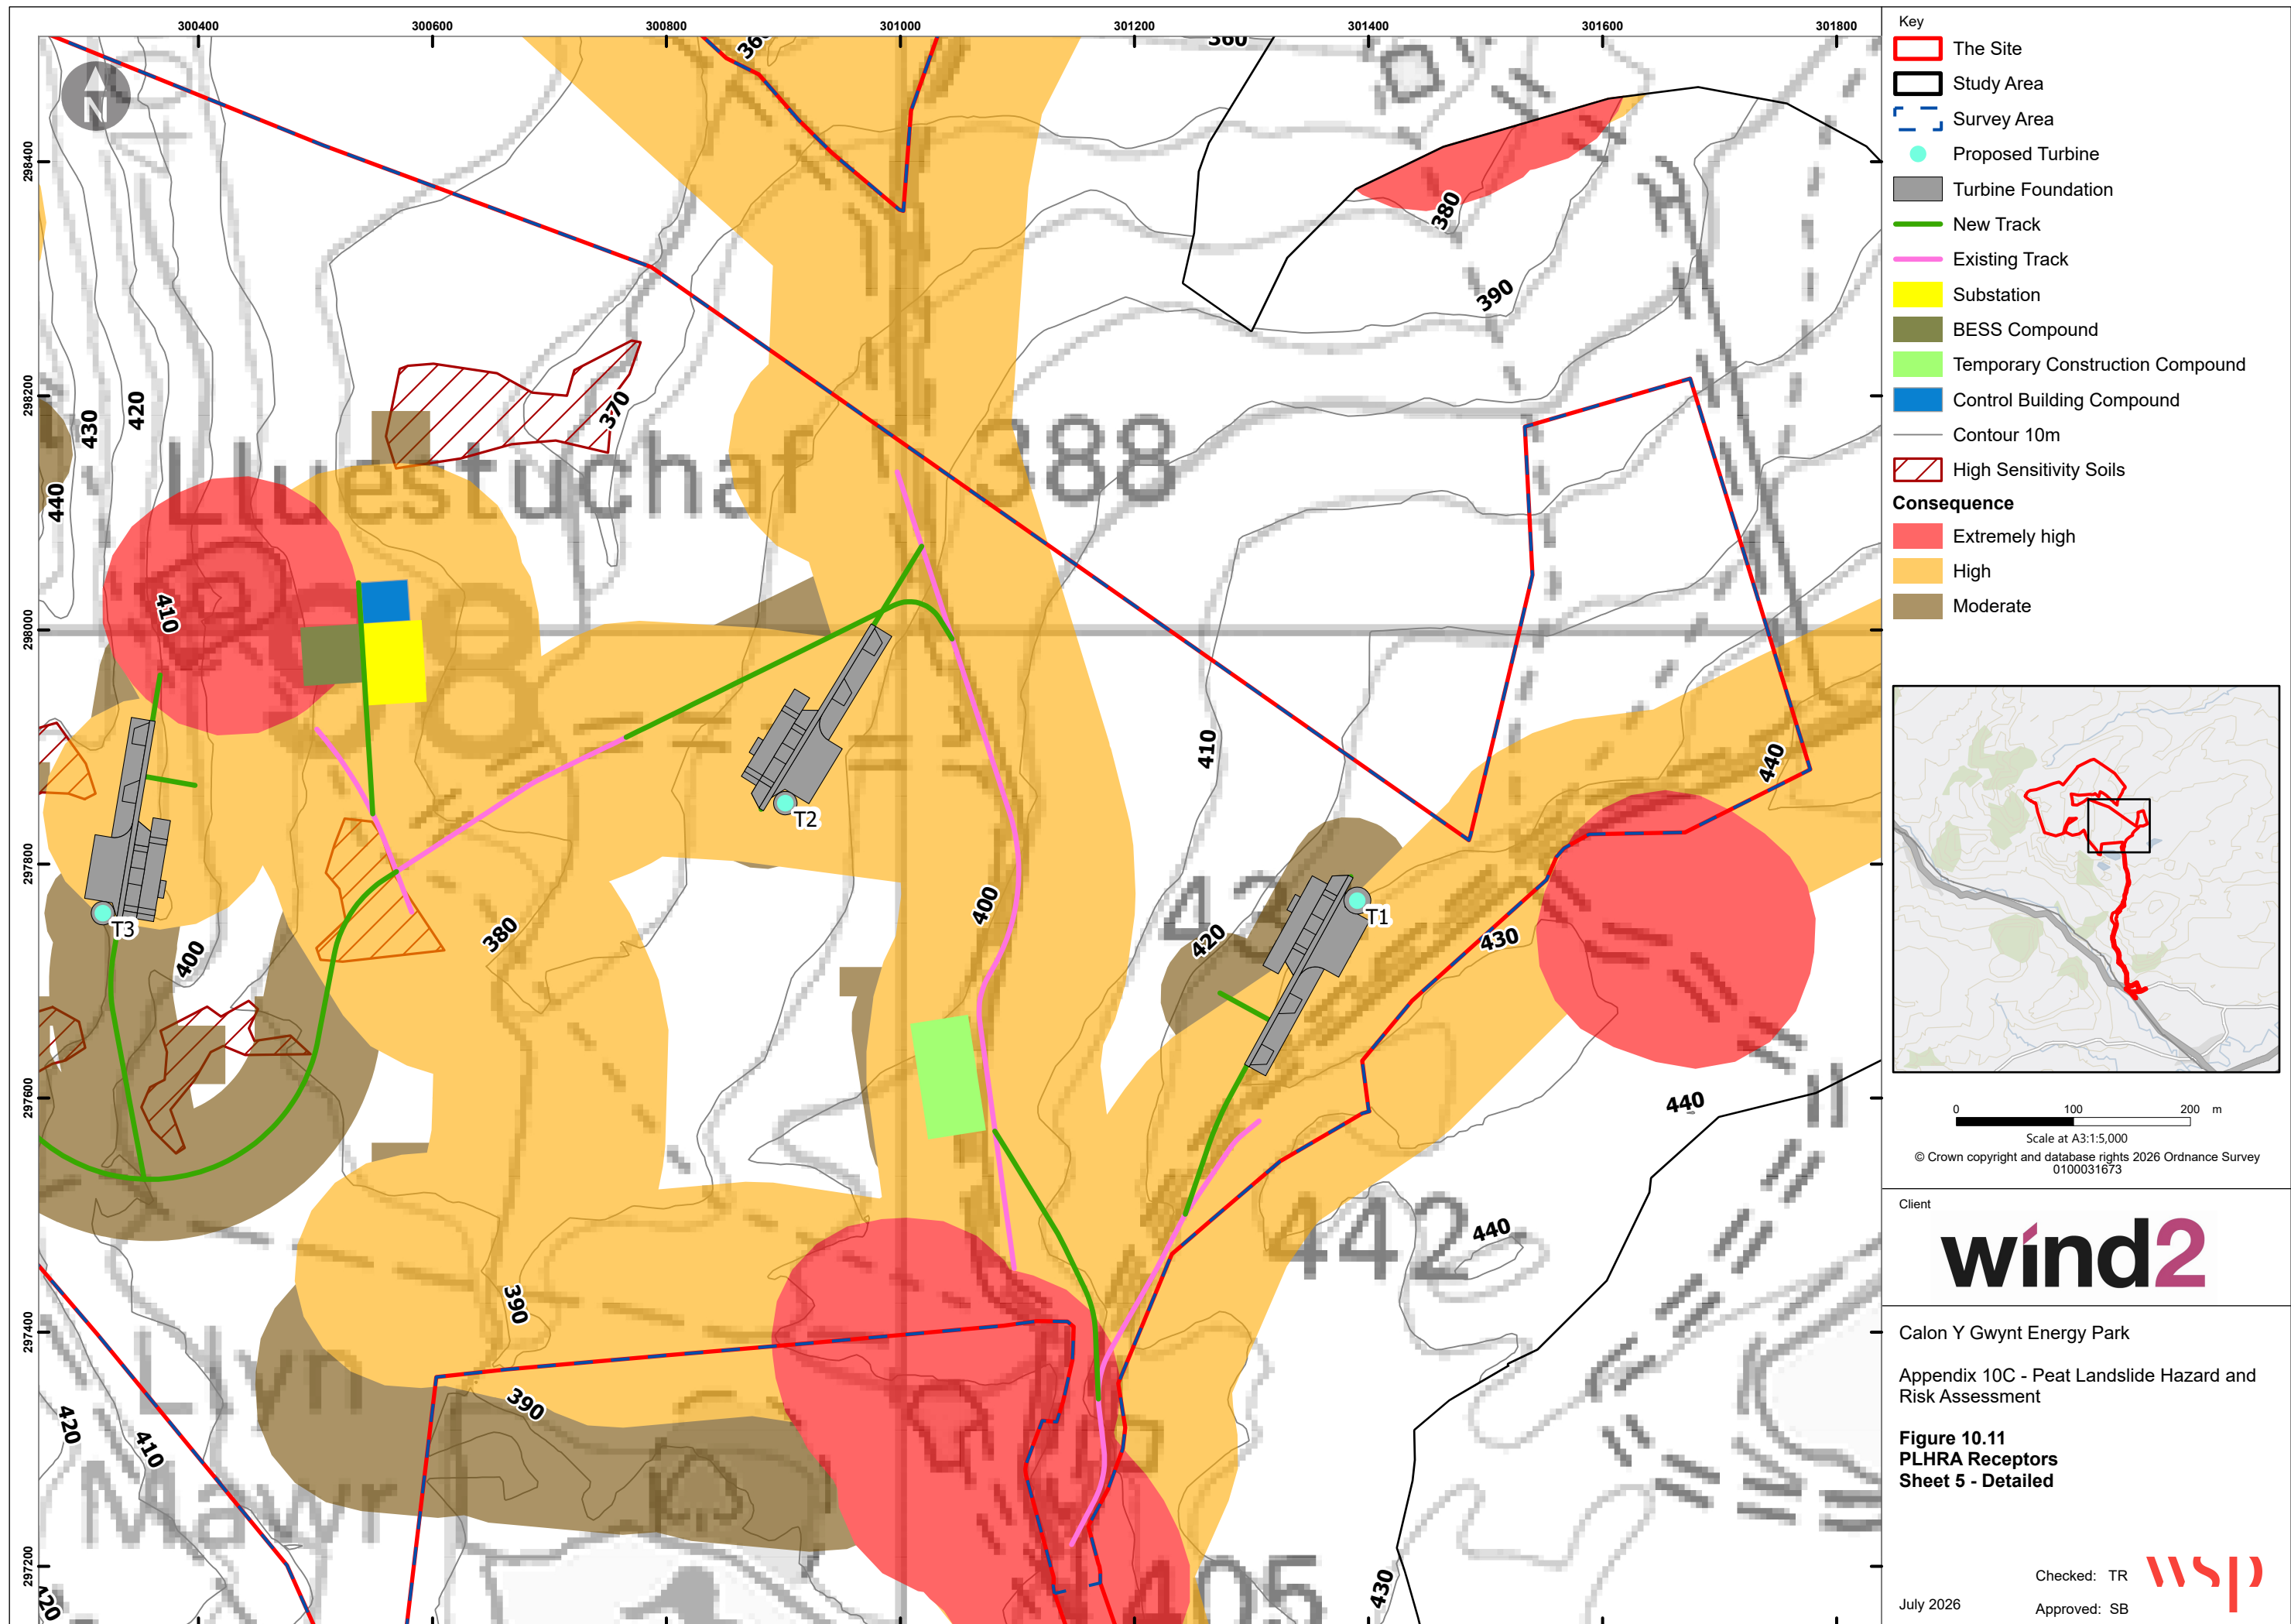

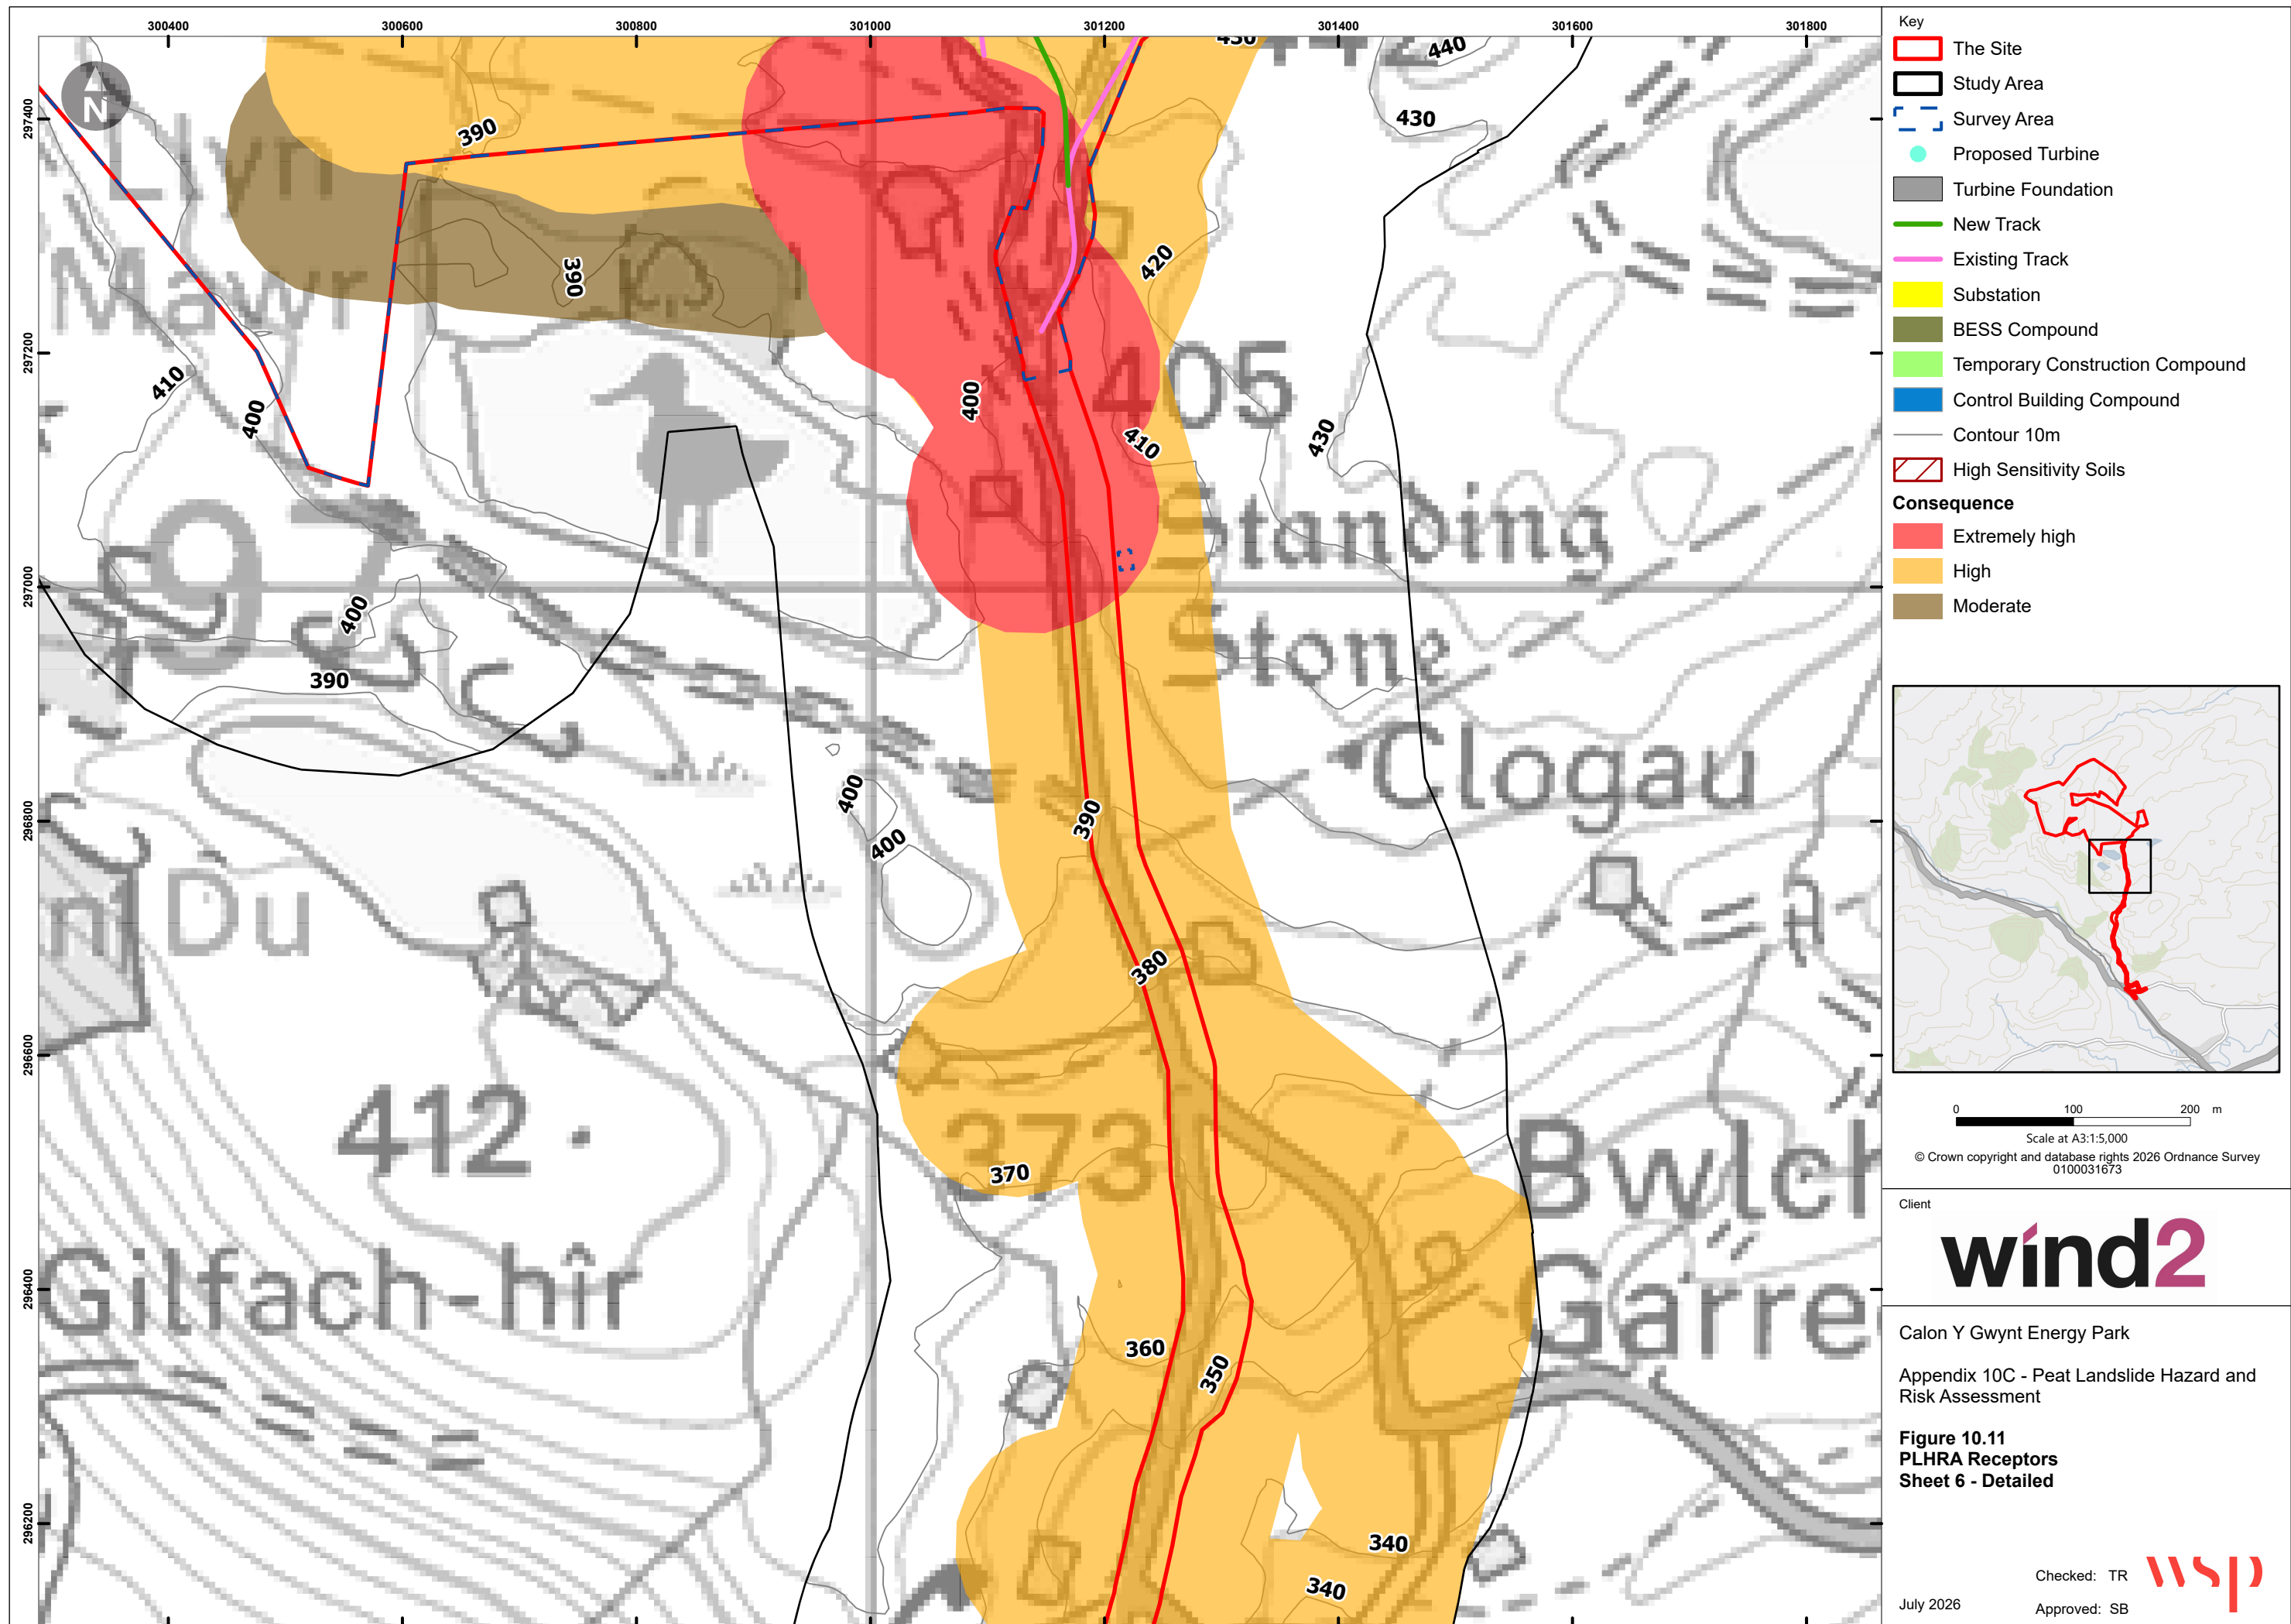

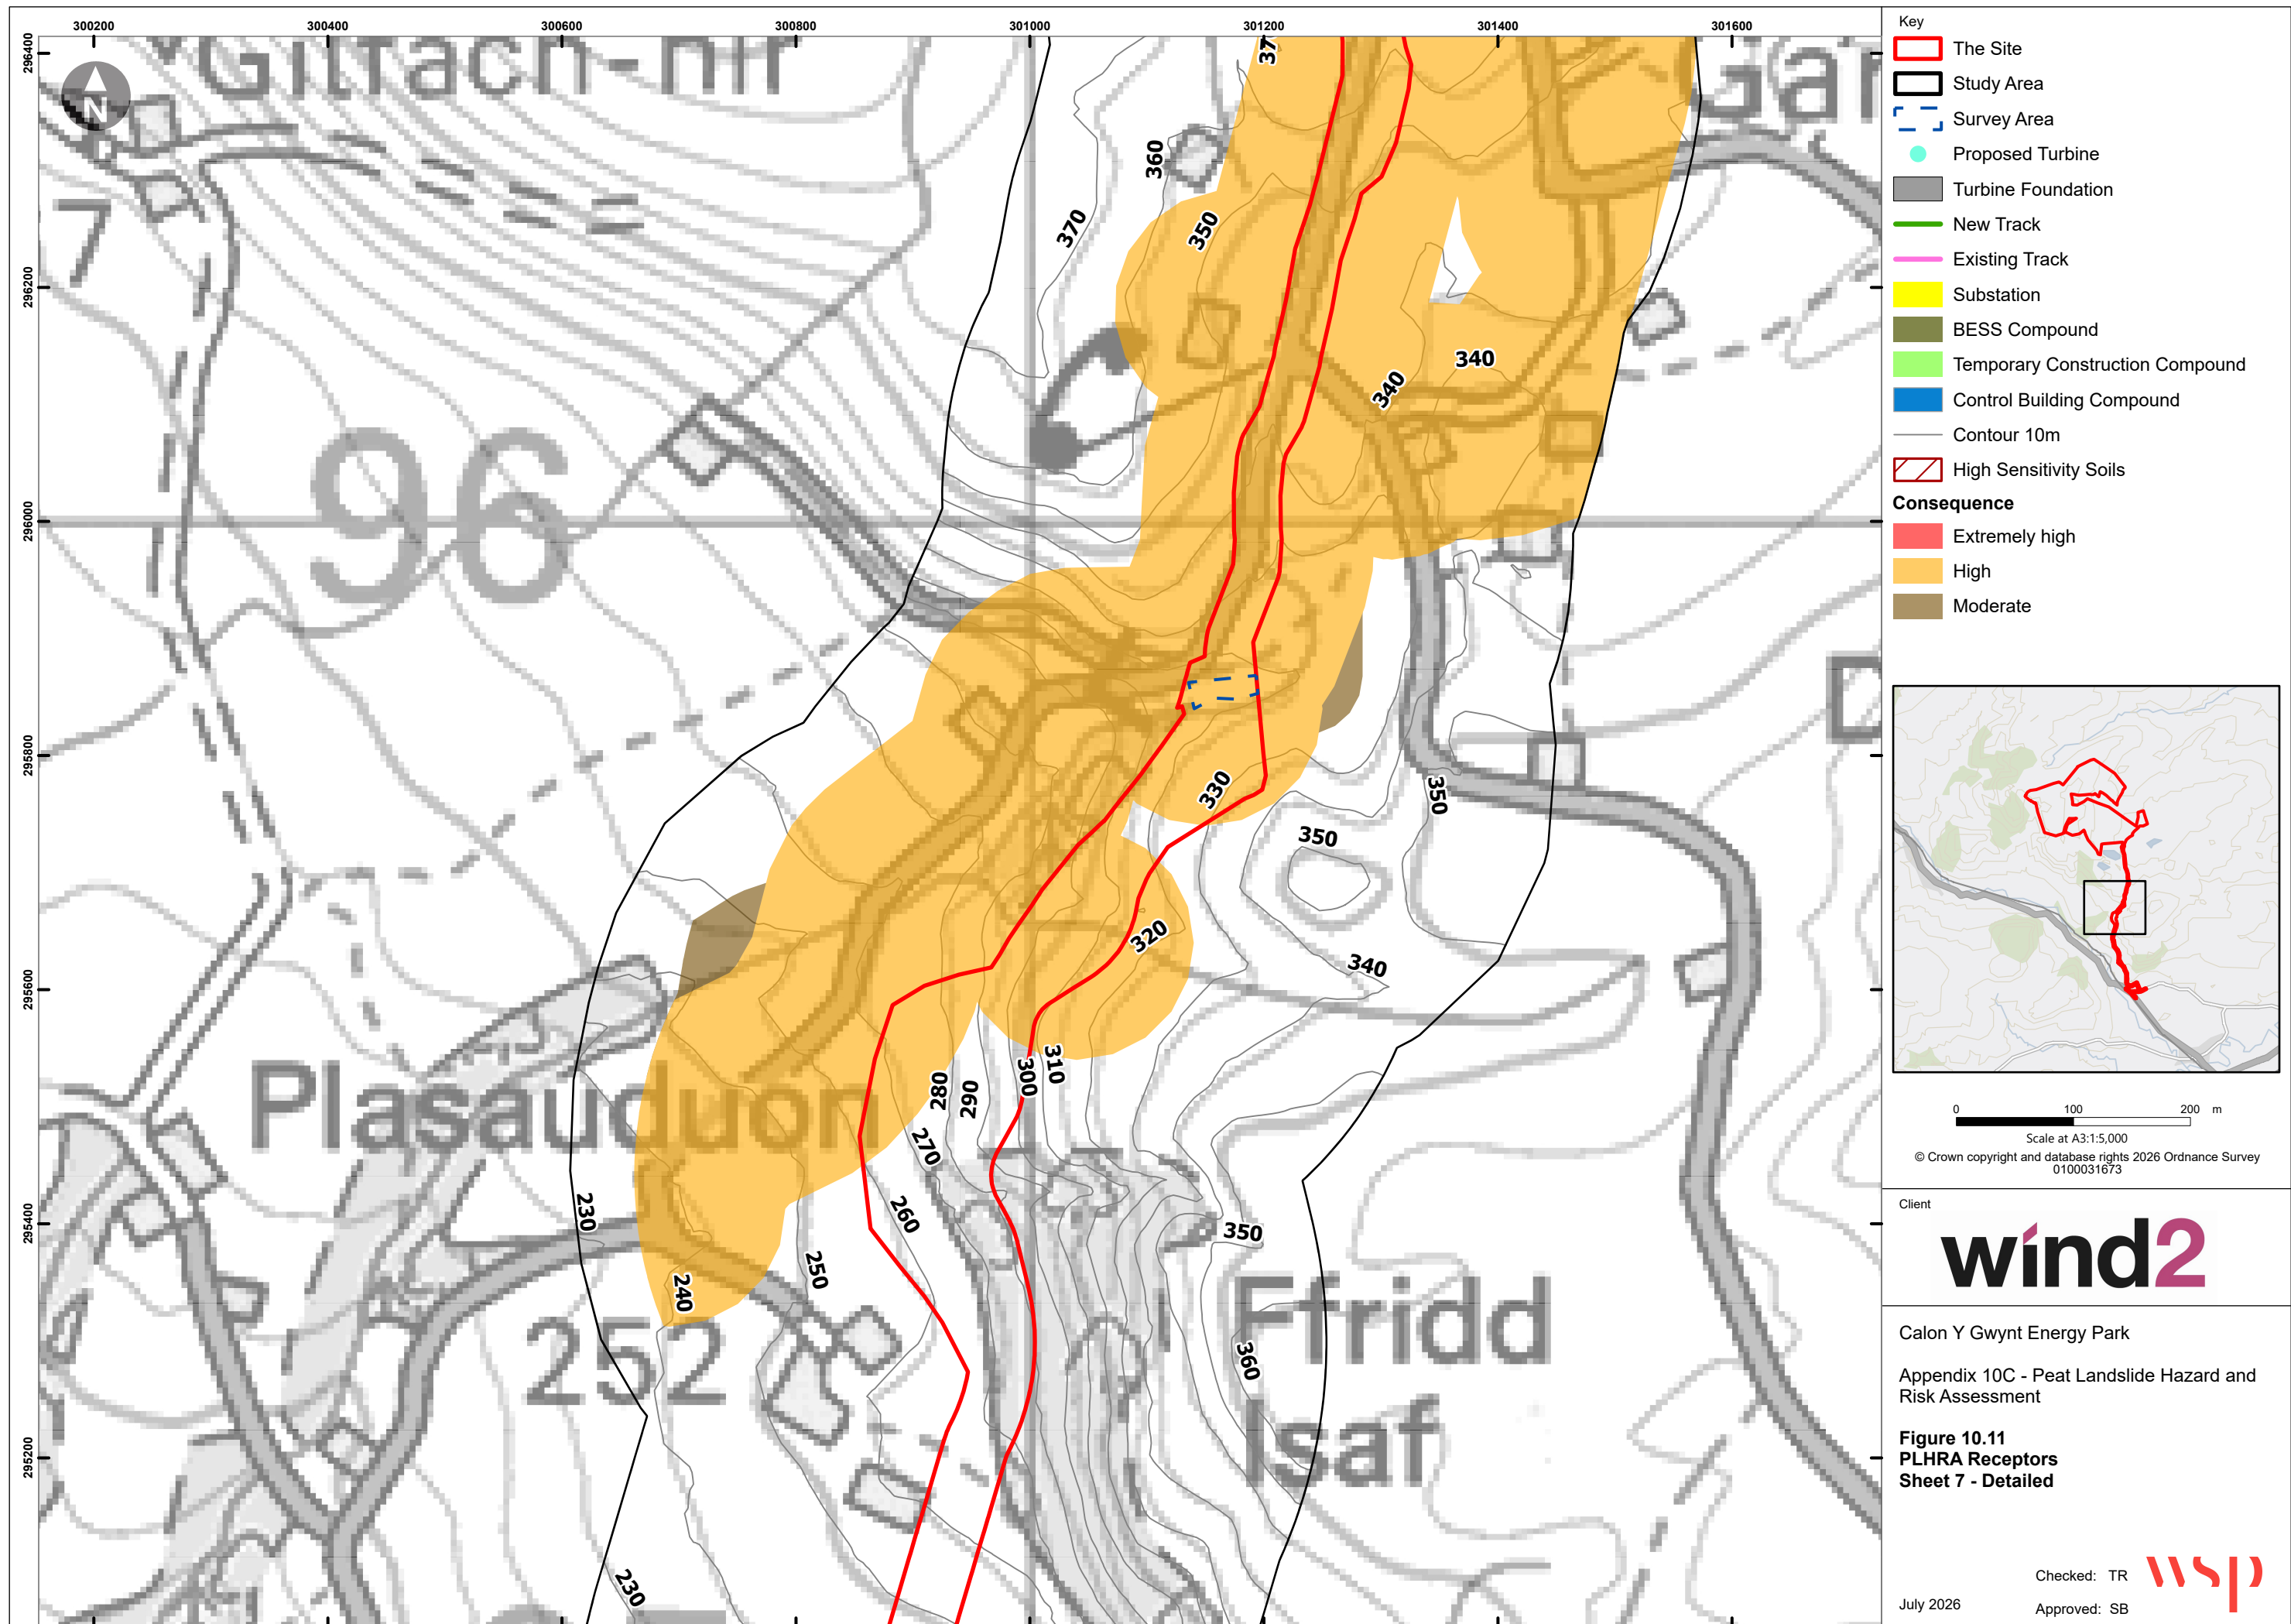

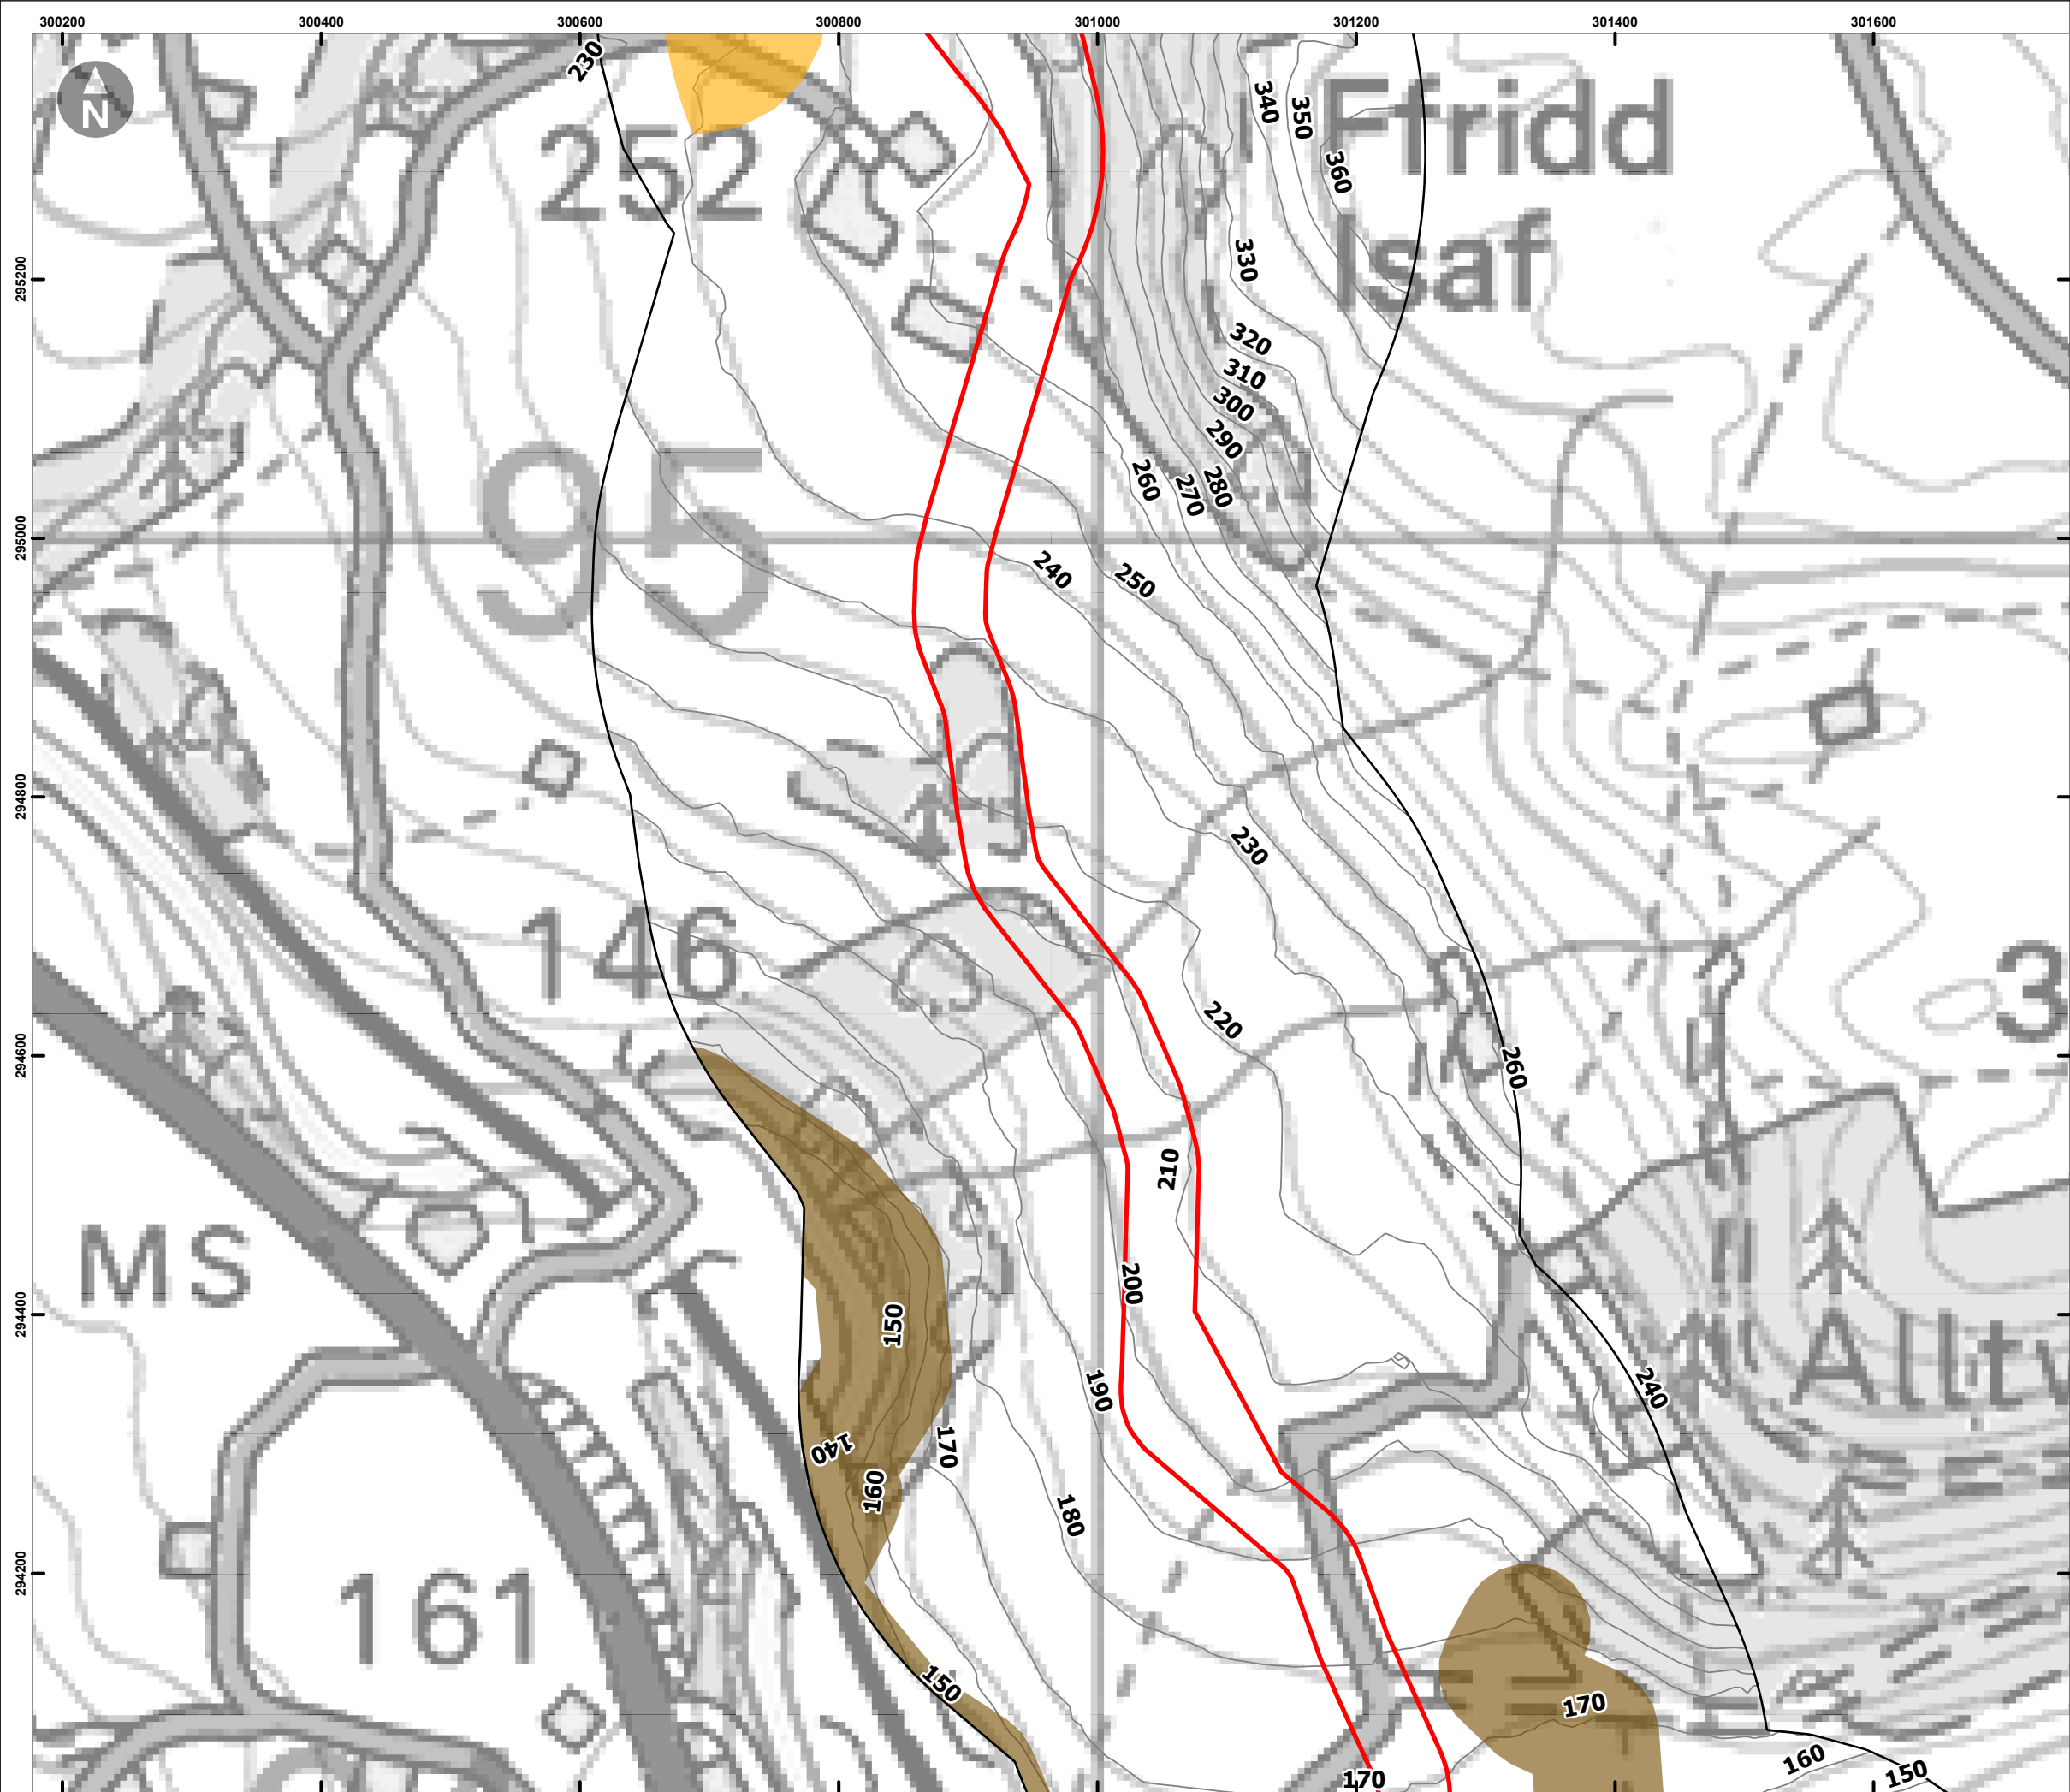


Key

- The Site
- Study Area
- Survey Area
- Proposed Turbine
- Turbine Foundation
- New Track
- Existing Track
- Substation
- BESS Compound
- Temporary Construction Compound
- Control Building Compound
- Contour 10m
- High Sensitivity Soils

Consequence

- Extremely high
- High
- Moderate

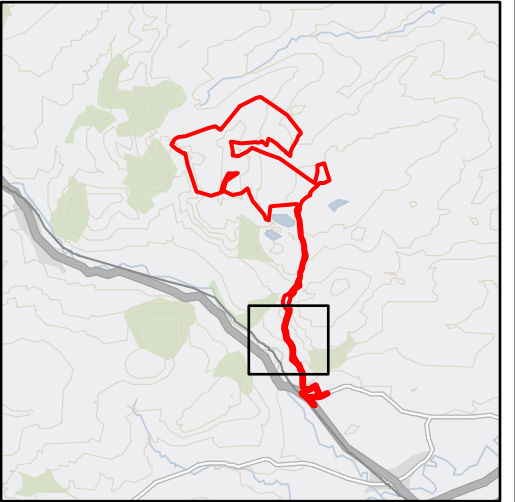

0 100 200 m
Scale at A3:1:5,000
© Crown copyright and database rights 2026 Ordnance Survey
0100031673

Client
wind2

Calon Y Gwynt Energy Park
Appendix 10C - Peat Landslide Hazard and Risk Assessment

Figure 10.11
PLHRA Receptors
Sheet 8 - Detailed

Checked: TR
Approved: SB
July 2026

