


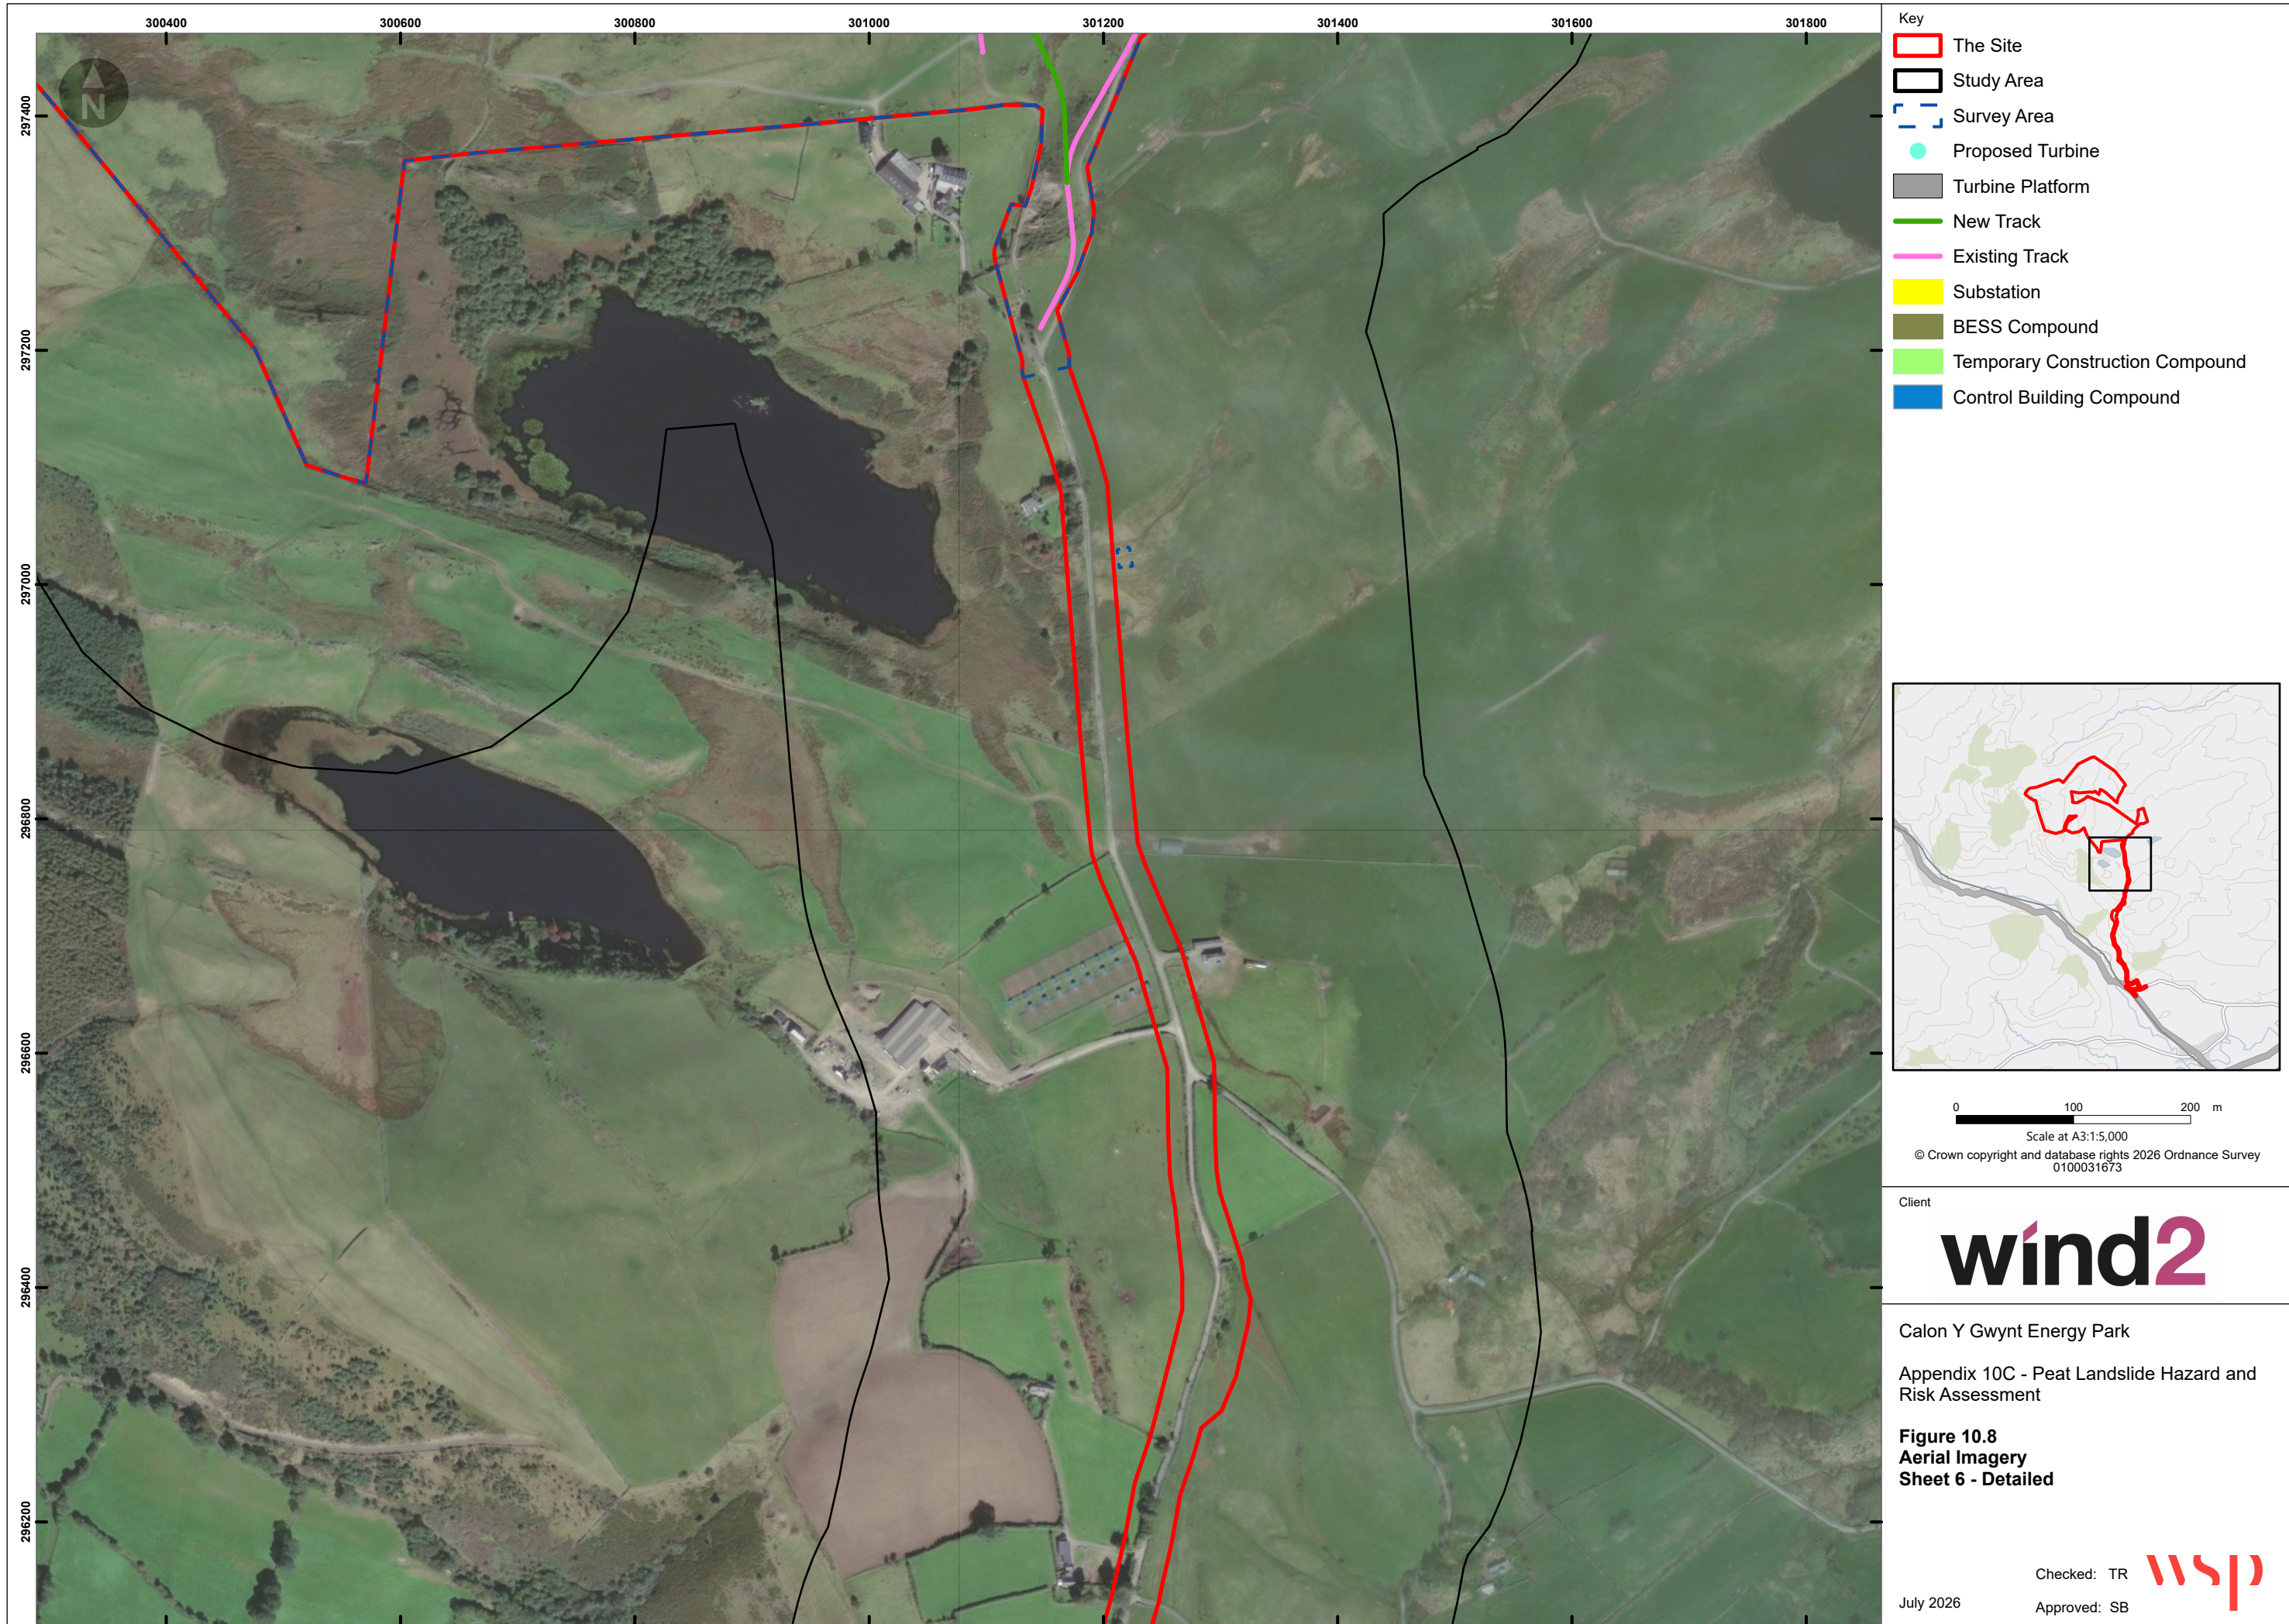


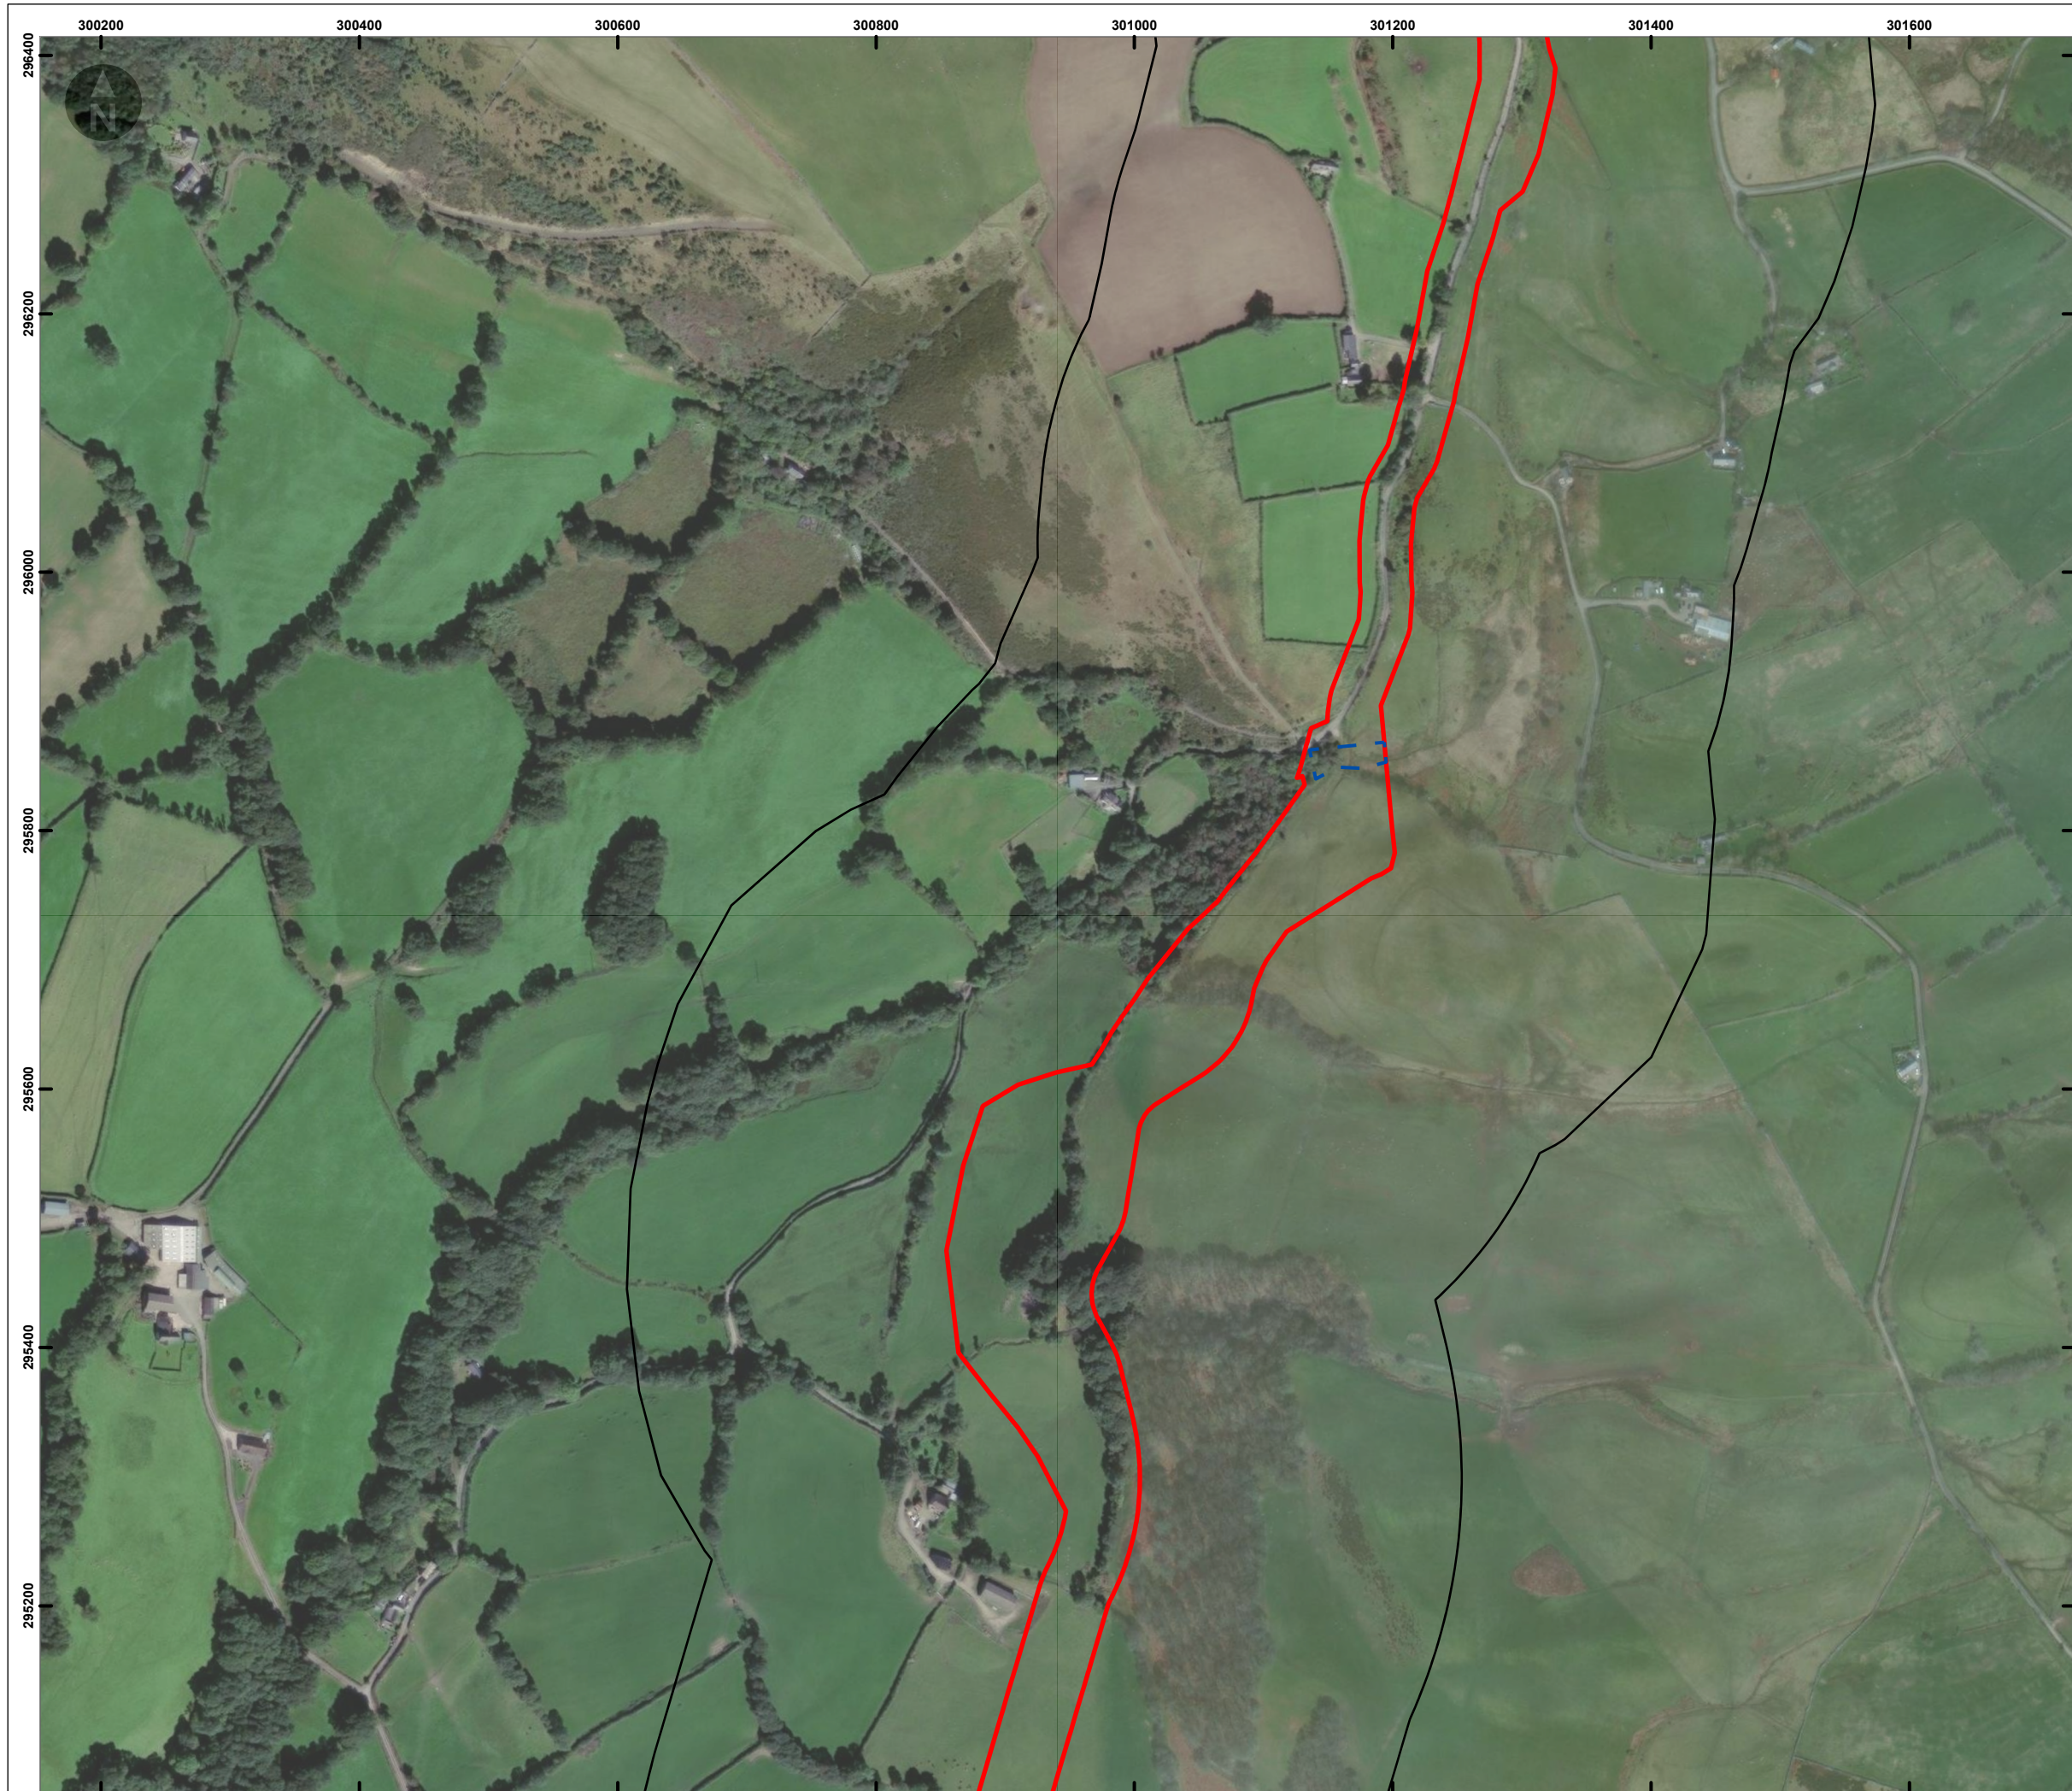



- Key
- The Site
 - Study Area
 - Survey Area
 - Proposed Turbine
 - Turbine Platform
 - New Track
 - Existing Track
 - Substation
 - BESS Compound
 - Temporary Construction Compound
 - Control Building Compound

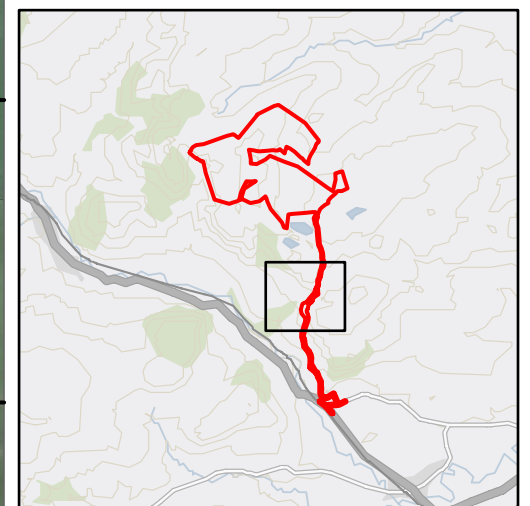

Scale at A3:1:5,000
© Crown copyright and database rights 2026 Ordnance Survey
0100031673

Client

wind2

Calon Y Gwynt Energy Park

Appendix 10C - Peat Landslide Hazard and Risk Assessment

Figure 10.8
Aerial Imagery
Sheet 7 - Detailed

Checked: TR
Approved: SB

July 2026

wsp

